


PLUS400-U (V D) DATA LOGGER

For damper ventilator

Afrimning


DATA	17/05/2005
DISEGN.	Banvicini
EQUATR.	

SOST. ILI	SOST. OAI
-----------	-----------



PLUS400-U (V D) DATA LOGGER

-	
+	
FDGLIO 1	
F.S. 2	T.F. 5

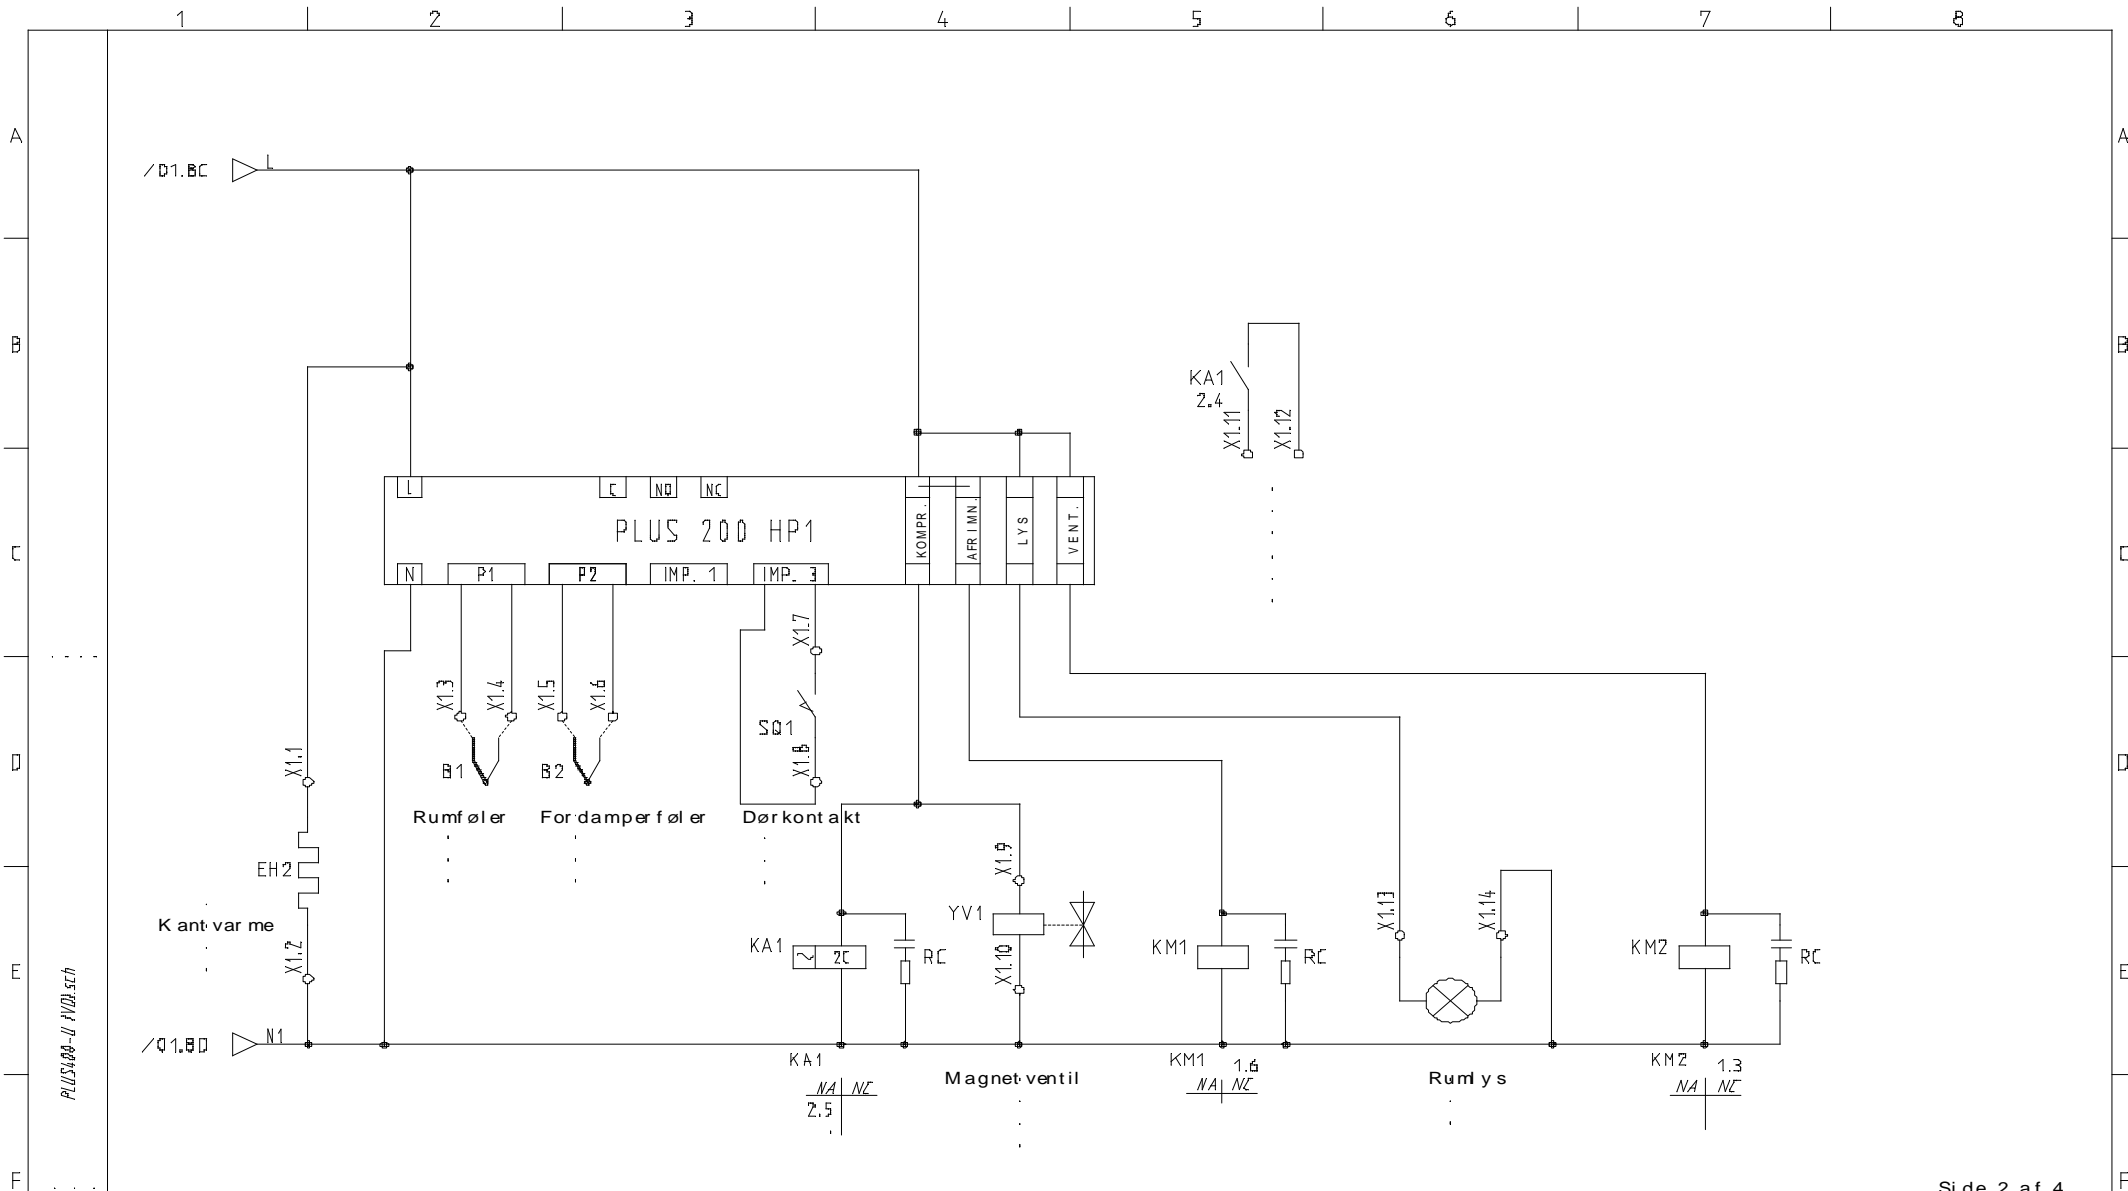

PLUS400-U (VD) SCHED

DATA	31/08/2004	 Electrical Boards	PLUS400-U (VD) DATALOGGER	-
DISEGN.	TESTONI			+
CONTR.				FOGLIO 2
SOST. IL:	SOST. DA:			F.S. X1-001 T.F. 5

X1

Kant varme..	EH2	1	2.2
Kant varme..	EH2	2	2.2
Rumføler	B1	3	2.2
Rumføler	B1	4	2.2
For damperføler	B2	5	2.3
For damperføler	B2	6	2.3
Dørkontakt	SQ1	7	2.4
Dørkontakt	SQ1	8	2.4
Magnetventil	YV1	9	2.4
Magnetventil	YV1	10	2.4
Startsignal for kompr. unit (kan udelades)	KA1	11	2.5
Startsignal for kompr. unit (kan udelades)	KA1	12	2.5
Rumlys		13	2.6
Rumlys		14	2.6

DATA	13/07/2003
DIREKT	LULU
CONTR.	

RIEHLING MORSETTI
TERMINAL BOARD SUMMARY



PLUS400-U (VD) DATA LOGGER

Side 3 of 4

+	
FOGLID	XI-001
F.S.	X2-001 IT.F.5

DATA	13/07/2003
DESIGN.	LUCA
CNTR.	

RIEPILOGO MORSE TTI
TERMINAL BOARD SUMMARY



ELECTRICAL BOARDS


SIST. DA:

PLUS400-U (VD) DATALOGGER

SIST. DA:

+	
Foglio	X2-001
F.S.	IT.F.5

Side 4 of 4

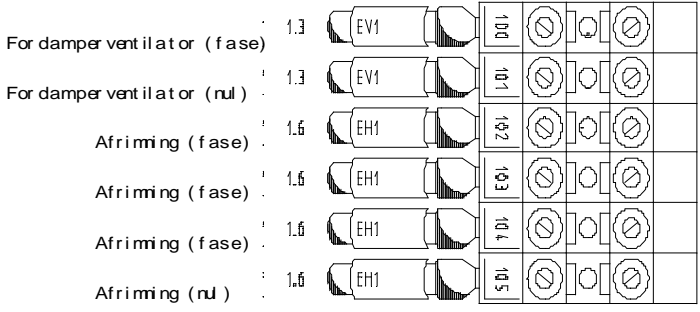

X2